


INSTALLATION INSTRUCTIONS


PLACE EXTENSION AGAINST FRONT OF SLEEVE
 ENSURE TOP AND SIDES ARE FLUSH
 ATTACH TO SLEEVE USING SELF TAPPING SCREWS PROVIDED
 IN 7 PLACES THREE IN THE TOP FLANGE AND TWO ON EACH SIDE

NOTE:

WHEN INSTALLING THE UNIT PROVISIONS MUST BE MADE TO EXTEND THE
 OUTSIDE FRESH AIR AND CONDENSING AIR EXHAUST DIVIDERS TO REACH
 THE EXTERIOR LOUVER. IF THIS IS NOT DONE THE AIR WILL RECIRCULATE AND
 THE UNIT WILL NOT RUN PROPERLY AND MAY FAIL PREMATURELY.

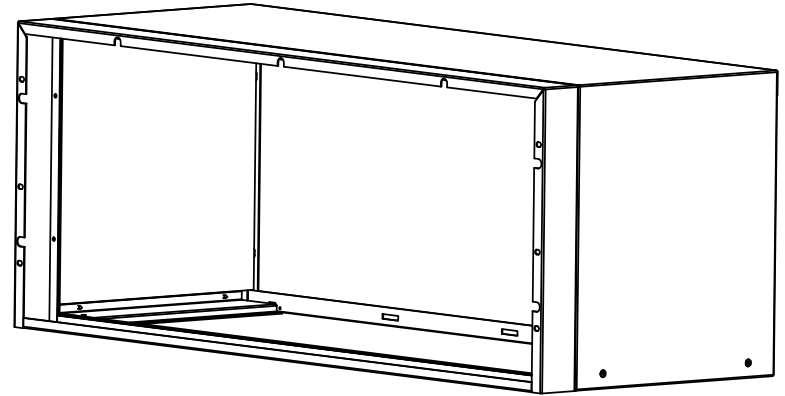

**SLEEVE EXTENSION ADDS 2 3/8" DEPTH
 TO THE INSIDE
 OF A 16x42" SLEEVE**

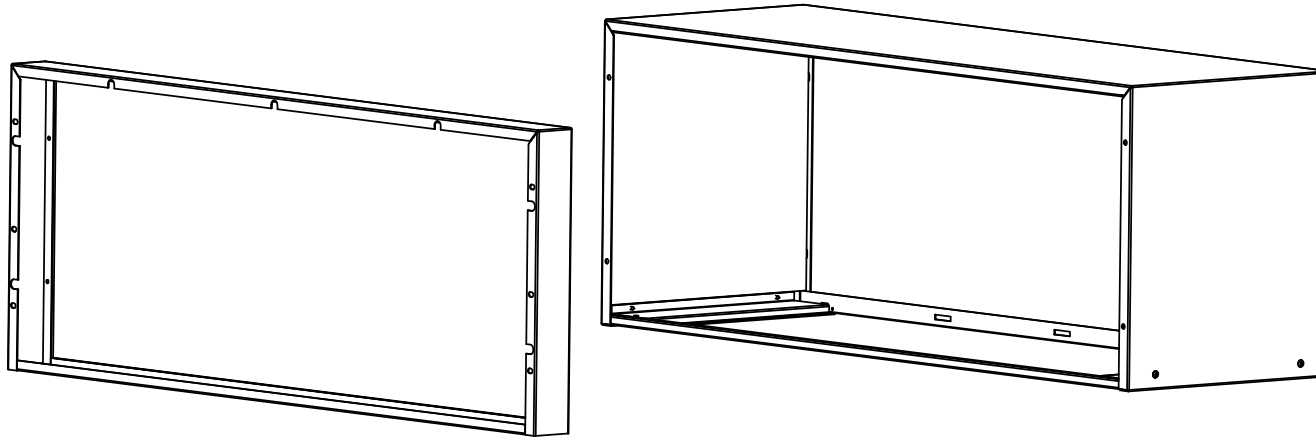

					NAME	DATE	
					DRAWN WWebber	24 Jul 2015	
					CHECKED		
					ENG APPR		
					MFG APPR		
					Q.A.		
					MATERIAL	COMMENTS:	
					FINISH		
REV	DATE	NOTES	BY	APPLICATION			DC NOT SCALE DRAWING



TITLE:
**SLEEVE EXTENSION
 INSTRUCTIONS**

SIZE G	DWG. NO. 804053	REV 00
SCALE: 1:10	WEIGHT:	SHEET 1 OF 1

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN THIS
 DRAWING IS THE SOLE PROPERTY OF
 <INSERT COMPANY NAME HERE>. ANY
 REPRODUCTION IN PART OR AS A WHOLE
 WITHOUT THE WRITTEN PERMISSION OF
 <INSERT COMPANY NAME HERE> IS
 PROHIBITED.